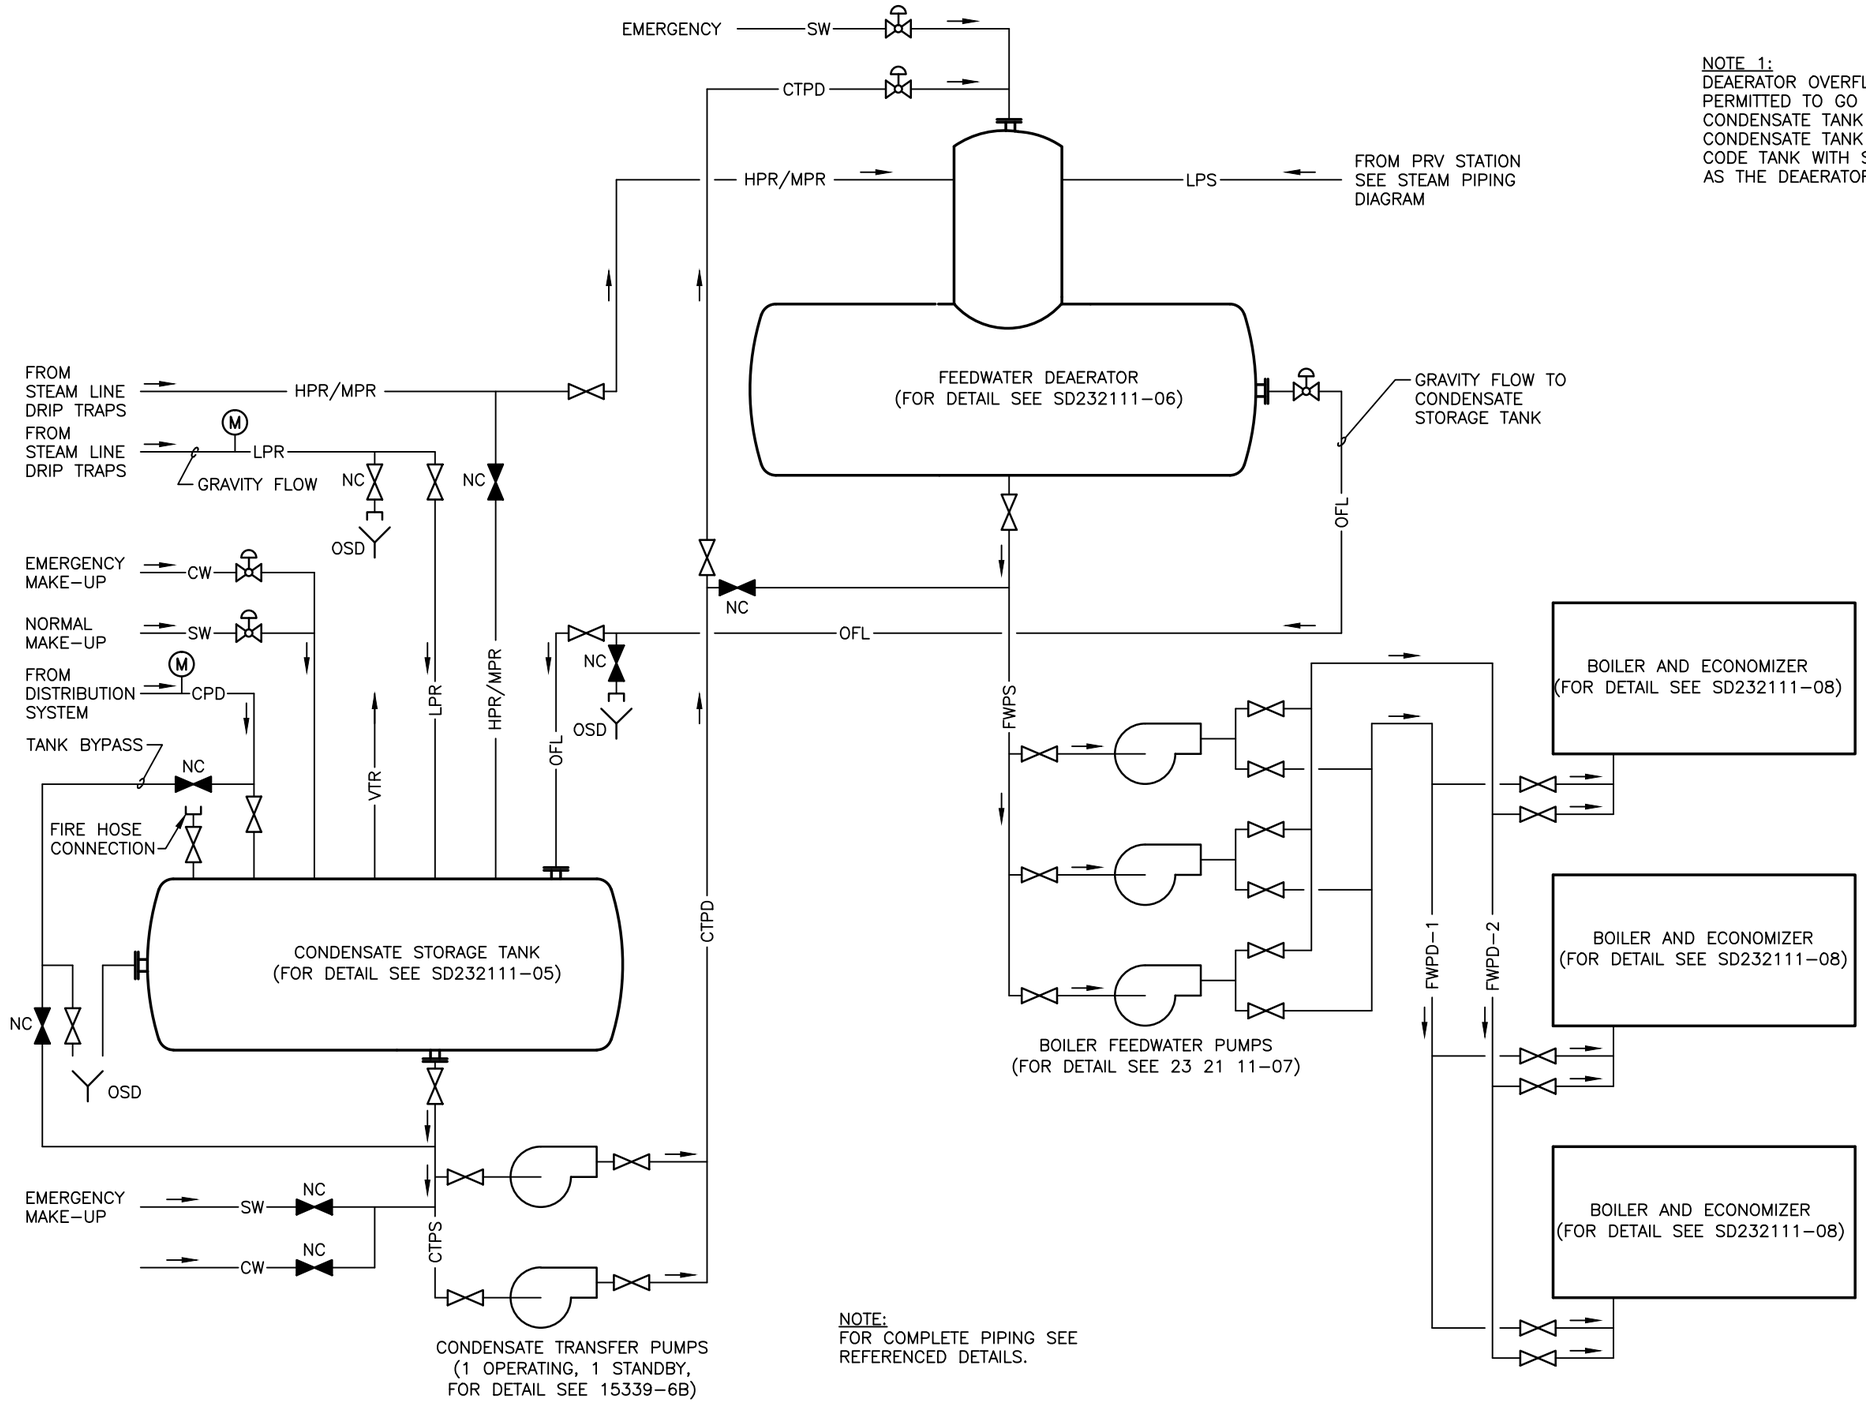

NOTE 1:
DEAERATOR OVERFLOW ONLY PERMITTED TO GO TO CONDENSATE TANK IF THE CONDENSATE TANK IS A ASME CODE TANK WITH SAME MAWP AS THE DEAERATOR.

NOTE:
FOR COMPLETE PIPING SEE REFERENCED DETAILS.

BASIC FLOW DIAGRAM - CONDENSATE AND BOILER FEEDWATER

NTS

DETAIL TITLE / CONDENSATE, BOILER FEEDWATER, BLOWOFF, CHEMICAL FEED, WATER SAMPLE

SCALE :NONE

DATE ISSUED: SEPTEMBER 2010

CAD DETAIL NO.: SD232111-04.DWG

Department of Veterans Affairs