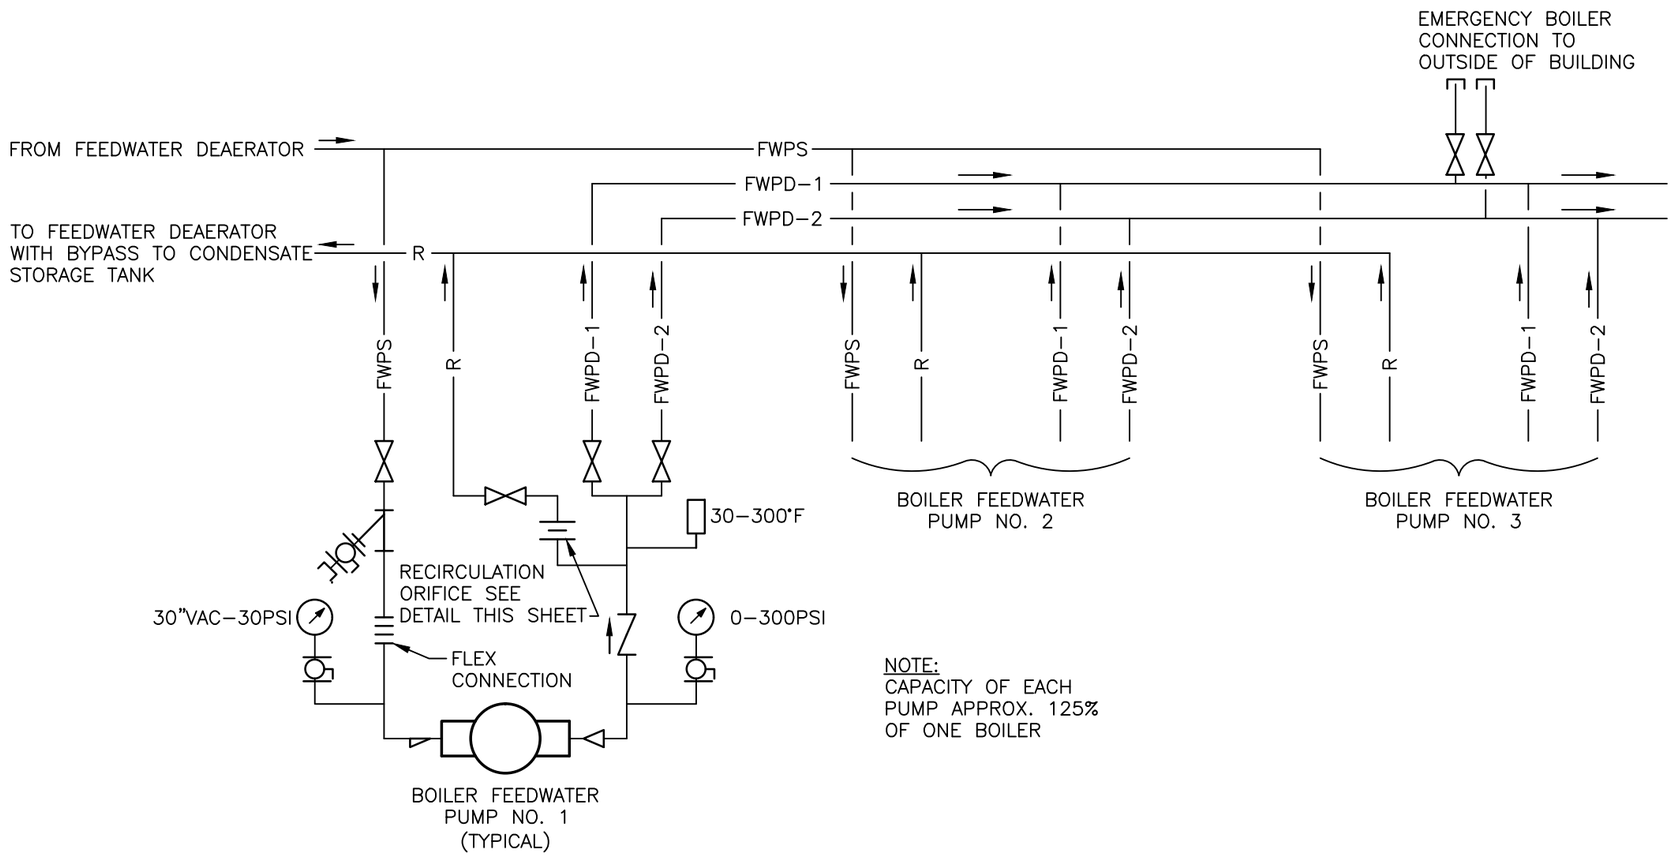

NOTE:
CAPACITY OF EACH PUMP APPROX. 125% OF ONE BOILER

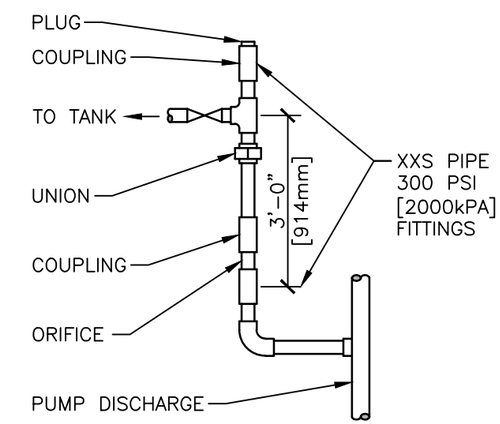

DETAIL – PUMP RECIRCULATION ORIFICE ASSEMBLY

BOILER FEEDWATER PUMPS FLOW DIAGRAM

NTS

DESIGNER NOTE: SEE SD232111–04 BASIC FLOW DIAGRAM – CONDENSATE AND BOILER FEEDWATER FOR COMPLETE SYSTEM.

DETAIL TITLE / BOILER FEEDWATER PUMPS FLOW DIAGRAM

SCALE :NONE

DATE ISSUED: SEPTEMBER 2010

CAD DETAIL NO.: SD232111–07.DWG

Department of Veterans Affairs