


DRAIN LINE SHALL BE AT LEAST THE SAME SIZE AS THE NIPPLE ON THE DRAIN PAN
 PIPING SHALL BE RIGID COPPER TYPE L OR TYPE M UNLESS NOTE BELOW IS MET

PITCH DOWN TOWARD DRAIN

CLEAN OUT

1"
[25mm]


FLOOR SINK

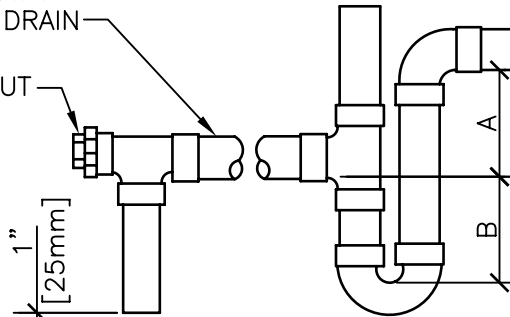

NOTE: 1. CPVC PIPE MAY BE USED ONLY IF APPROVED BY LOCAL VA AND IS INDOORS AND DOES NOT PASS THROUGH RATED BARRIERS.
 2. DIELECTRIC FITTING TO BE USED WHEN TWO DISSIMILAR METALS ARE TO BE CONNECTED.

UNIT TYPE	A	B
DRAW THRU	2" [50mm] PLUS X	X
BLOW THRU	1" [25mm] MINIMUM	2X

WHERE X = STATIC PRESSURE IN PAN



AIR HANDLING UNIT DRAIN TRAP DETAIL

NTS



Department of
Veterans Affairs

DETAIL TITLE / AIR HANDLING UNIT DRAIN TRAP DETAIL

SCALE :NONE

DATE ISSUED: DECEMBER 2008

CAD DETAIL NO.: SD232113-08.DWG