



PIPE HANGERS – PROVIDE DOUBLE DEFLECTION NEOPRENE (TYPE HN) FOR FIRST TWO ON EACH SIDE OF PUMP (SEE NOTE NO. 1)

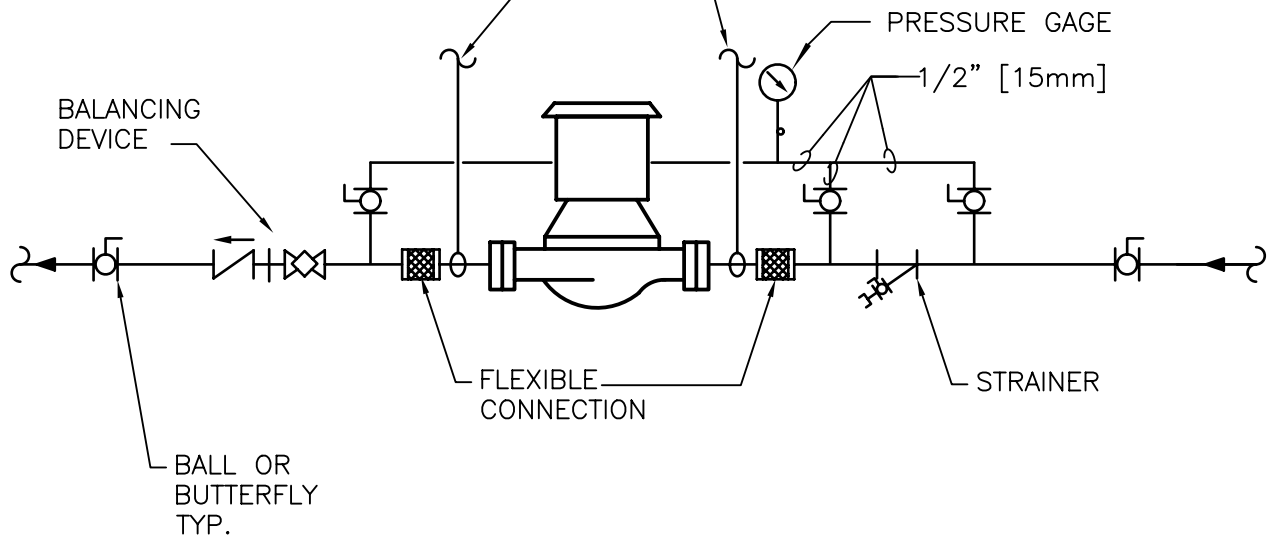

NOTES:

1. SUPPORT PUMP FROM PIPING ONLY. DO NOT SUPPORT PUMP FROM MOTOR.



## IN-LINE PUMPS – CONNECTIONS

NTS

DESIGNER'S NOTE:

1. CHECK VALVE IS OPTIONAL FOR SINGLE PUMP, EXCEPT FOR COOLING TOWER PUMP.
2. ELIMINATE BALANCING DEVICE WHEN PUMP CONTROLLED BY VARIABLE SPEED DRIVE.



Department of  
Veterans Affairs

DETAIL TITLE / IN-LINE PUMPS – CONNECTIONS

SCALE :NONE

DATE ISSUED :DECEMBER 2008

CADD DETAIL NO. : SD232123-01.DWG