
1. PROVIDE MINIMUM 3/4" (19mm) (MIN.) EMT CONDUIT FOR ALL FIRE ALARM WIRING. PROVIDE BUSHINGS FOR ALL WIRING ENTRIES INTO JUNCTION BOXES.

PROVIDE DUCT SMOKE DETECTOR REMOTE INDICATOR TEST SWITCH AT 6 FEET (2m) ABOVE THE FINISH FLOOR INSIDE MECHANICAL ROOM ADJACENT TO DOOR.

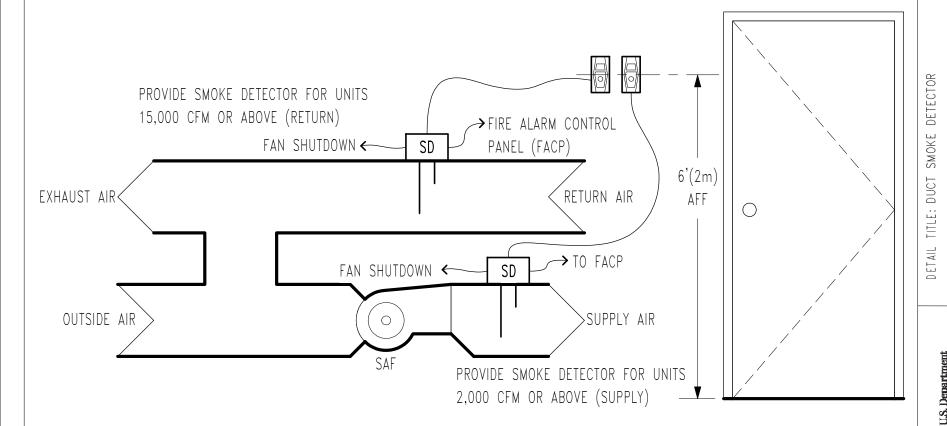

DUCT SMOKE DETECTOR

NOTE: