



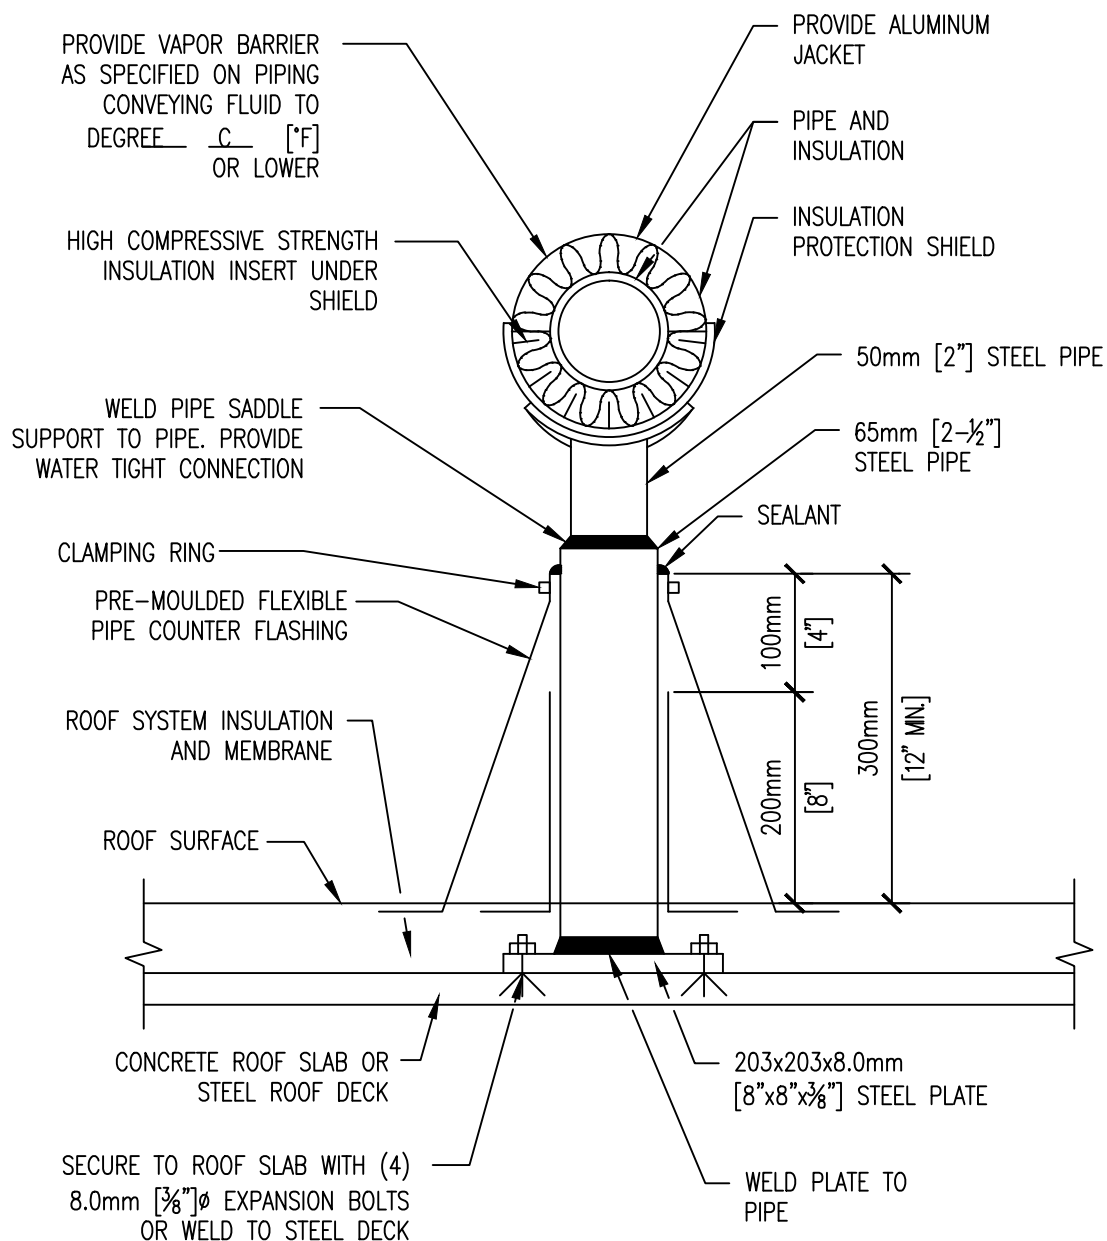

NOTES:

PROVIDE RESTRAINING CLAMPS 2438mm [8'-0"] O.C.



DETAIL FOR SUPPORTING PIPE ON ROOF

NTS



Department of
Veterans Affairs

DETAIL TITLE: DETAIL FOR SUPPORTING PIPE ON ROOF

SCALE :NONE

DATE ISSUED: 11/01/2017

CAD DETAIL NO.: SD230511-22.DWG