




Department of
Veterans Affairs

DETAIL TITLE: HEAT EXCHANGER - STEAM TO HOT WATER

SCALE :NONE


DATE ISSUED: 11/01/2017

CAD DETAIL NO.: SD232113-11.DWG

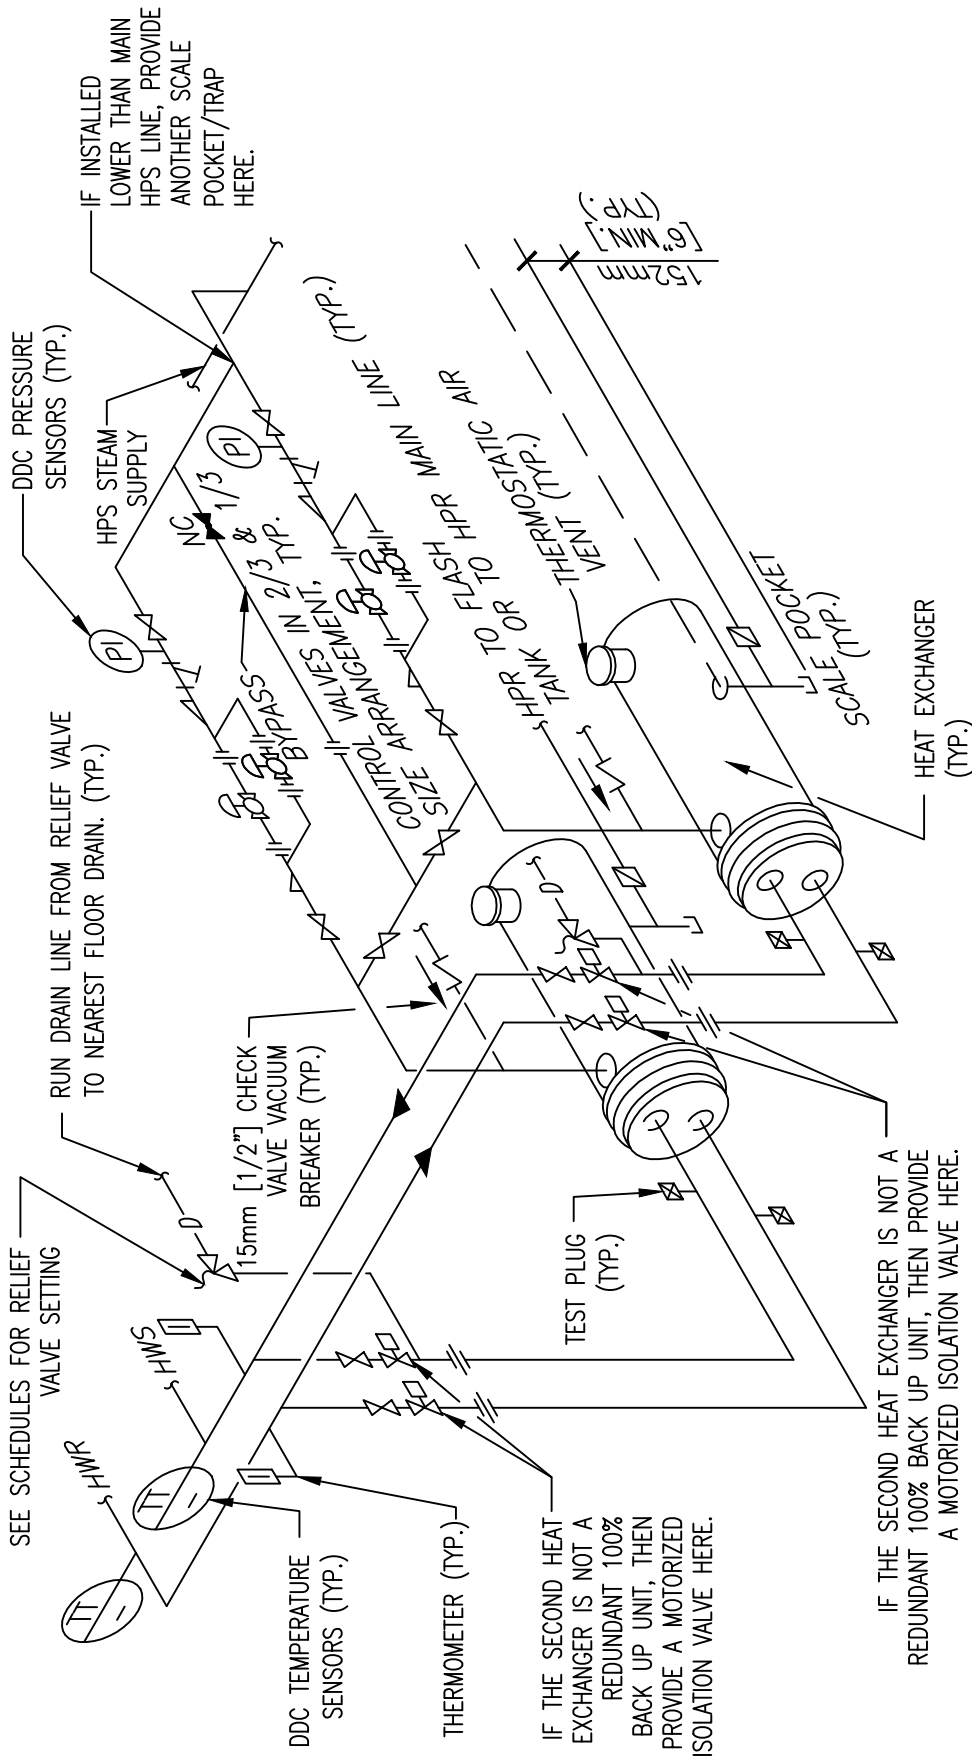

NOTES:

1. THE ABOVE DETAIL SHOWS REQUIRED PIPING FOR TWO HEAT EXCHANGERS IN PARALLEL. INDICATE IF 100% REDUNDANT OR NOT.
2. PROVIDE SADDLE SUPPORTS AND LEGS OR HANGERS FOR HEAT EXCHANGER. MOUNTING HEIGHT SHALL BE ADJUSTED TO FACILITATE GRAVITY RETURN OF STEAM CONDENSATE.
3. MAKE THE BYPASS THE SAME SIZE AS THE CONNECTIONS TO THE CONTROL VALVES.
4. CONTROL VALVES SHALL BE IN A 3 AND 3 SIZE ARRANGEMENT.



HEAT EXCHANGER - STEAM TO HOT WATER

NTS