




Department of
Veterans Affairs

DETAIL TITLE: EQUIPMENT ANCHORING—PACKAGED BOILER AND
DAEERATOR AND CONDENSATE STORAGE TANKS

SCALE :NONE

DATE ISSUED :11/01/2017

CADD DETAIL NO. : SD235011-10.DWG

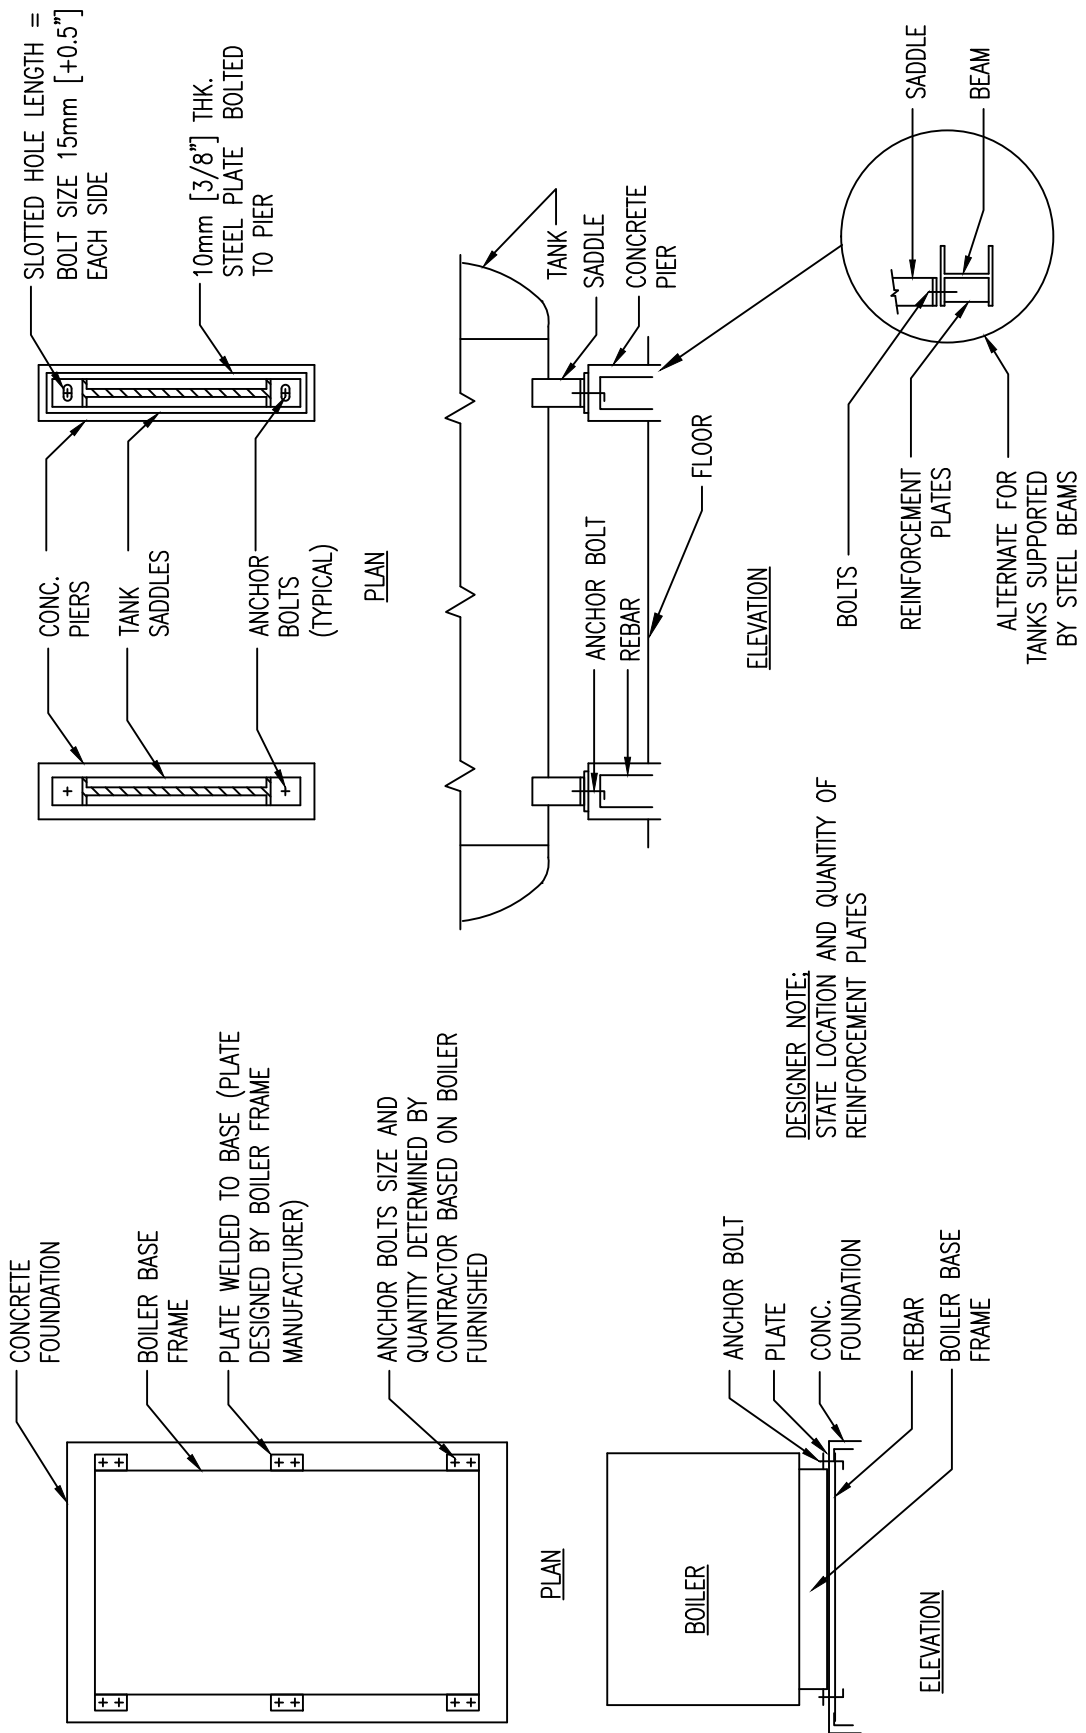

- NOTES:**
1. REFER TO SYMBOL AND SCHEDULE SHEETS FOR SEISMIC FORCE DESIGN INFORMATION
 2. PROVIDE SLOTTED HOLES IN PLATES TO ALLOW THERMAL EXPANSION IF RECOMMENDED BY BOILER MANUFACTURER

EQUIPMENT ANCHORING - PACKAGED BOILER AND DEAERATOR AND CONDENSATE STORAGE TANKS

NTS

#