



RUNOUT & INTERCONNECTING  
 PIPING. PROVIDE DIELECTRIC  
 FITTINGS AS REQUIRED. CIRCUIT TO  
 COMPLY WITH SPECIFIED CAPACITY  
 & PRESSURE DROP. (TYP.)

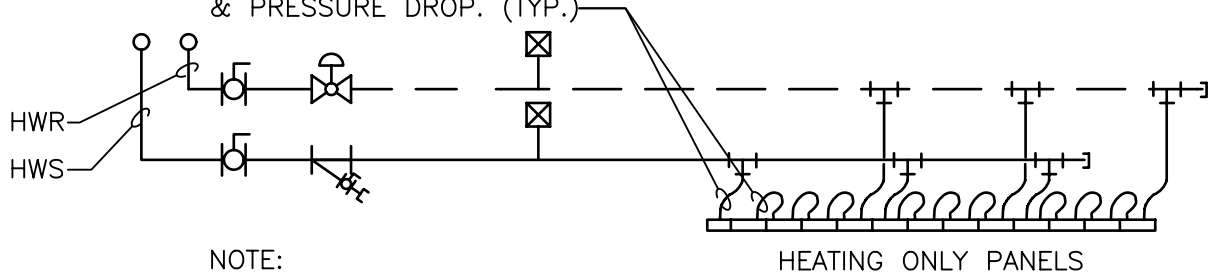

NOTE:

1. MINIMUM FLOW SHALL BE NO LESS THAN 0.5 GPM [1.9 LPM]

## HYDRONIC RADIANT CEILING PANELS - PIPING CONNECTIONS



NTS



Department of  
 Veterans Affairs

DETAIL TITLE / HYDRONIC RADIANT CEILING PANELS -  
 PIPING CONNECTIONS

SCALE :NONE

DATE ISSUED: DECEMBER 2008

CAD DETAIL NO.: SD238200-05.DWG